
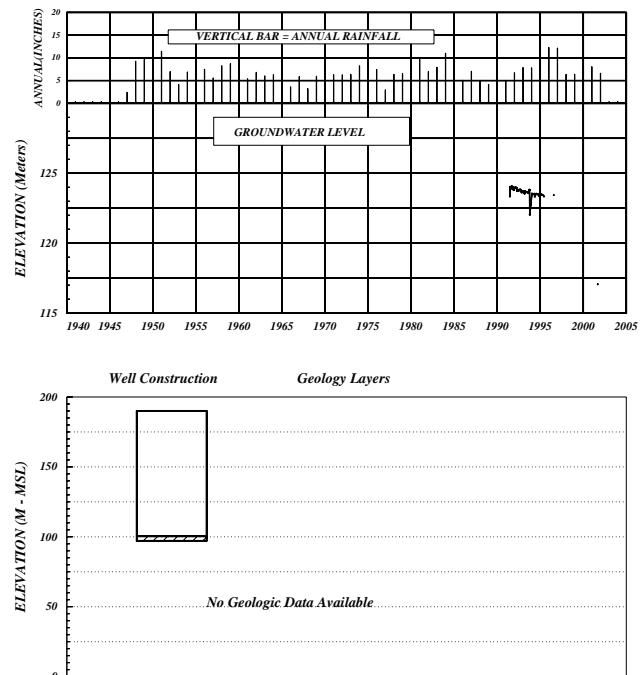
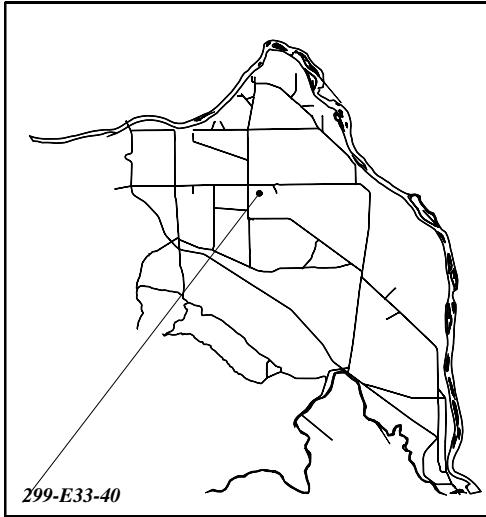


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-E33-40


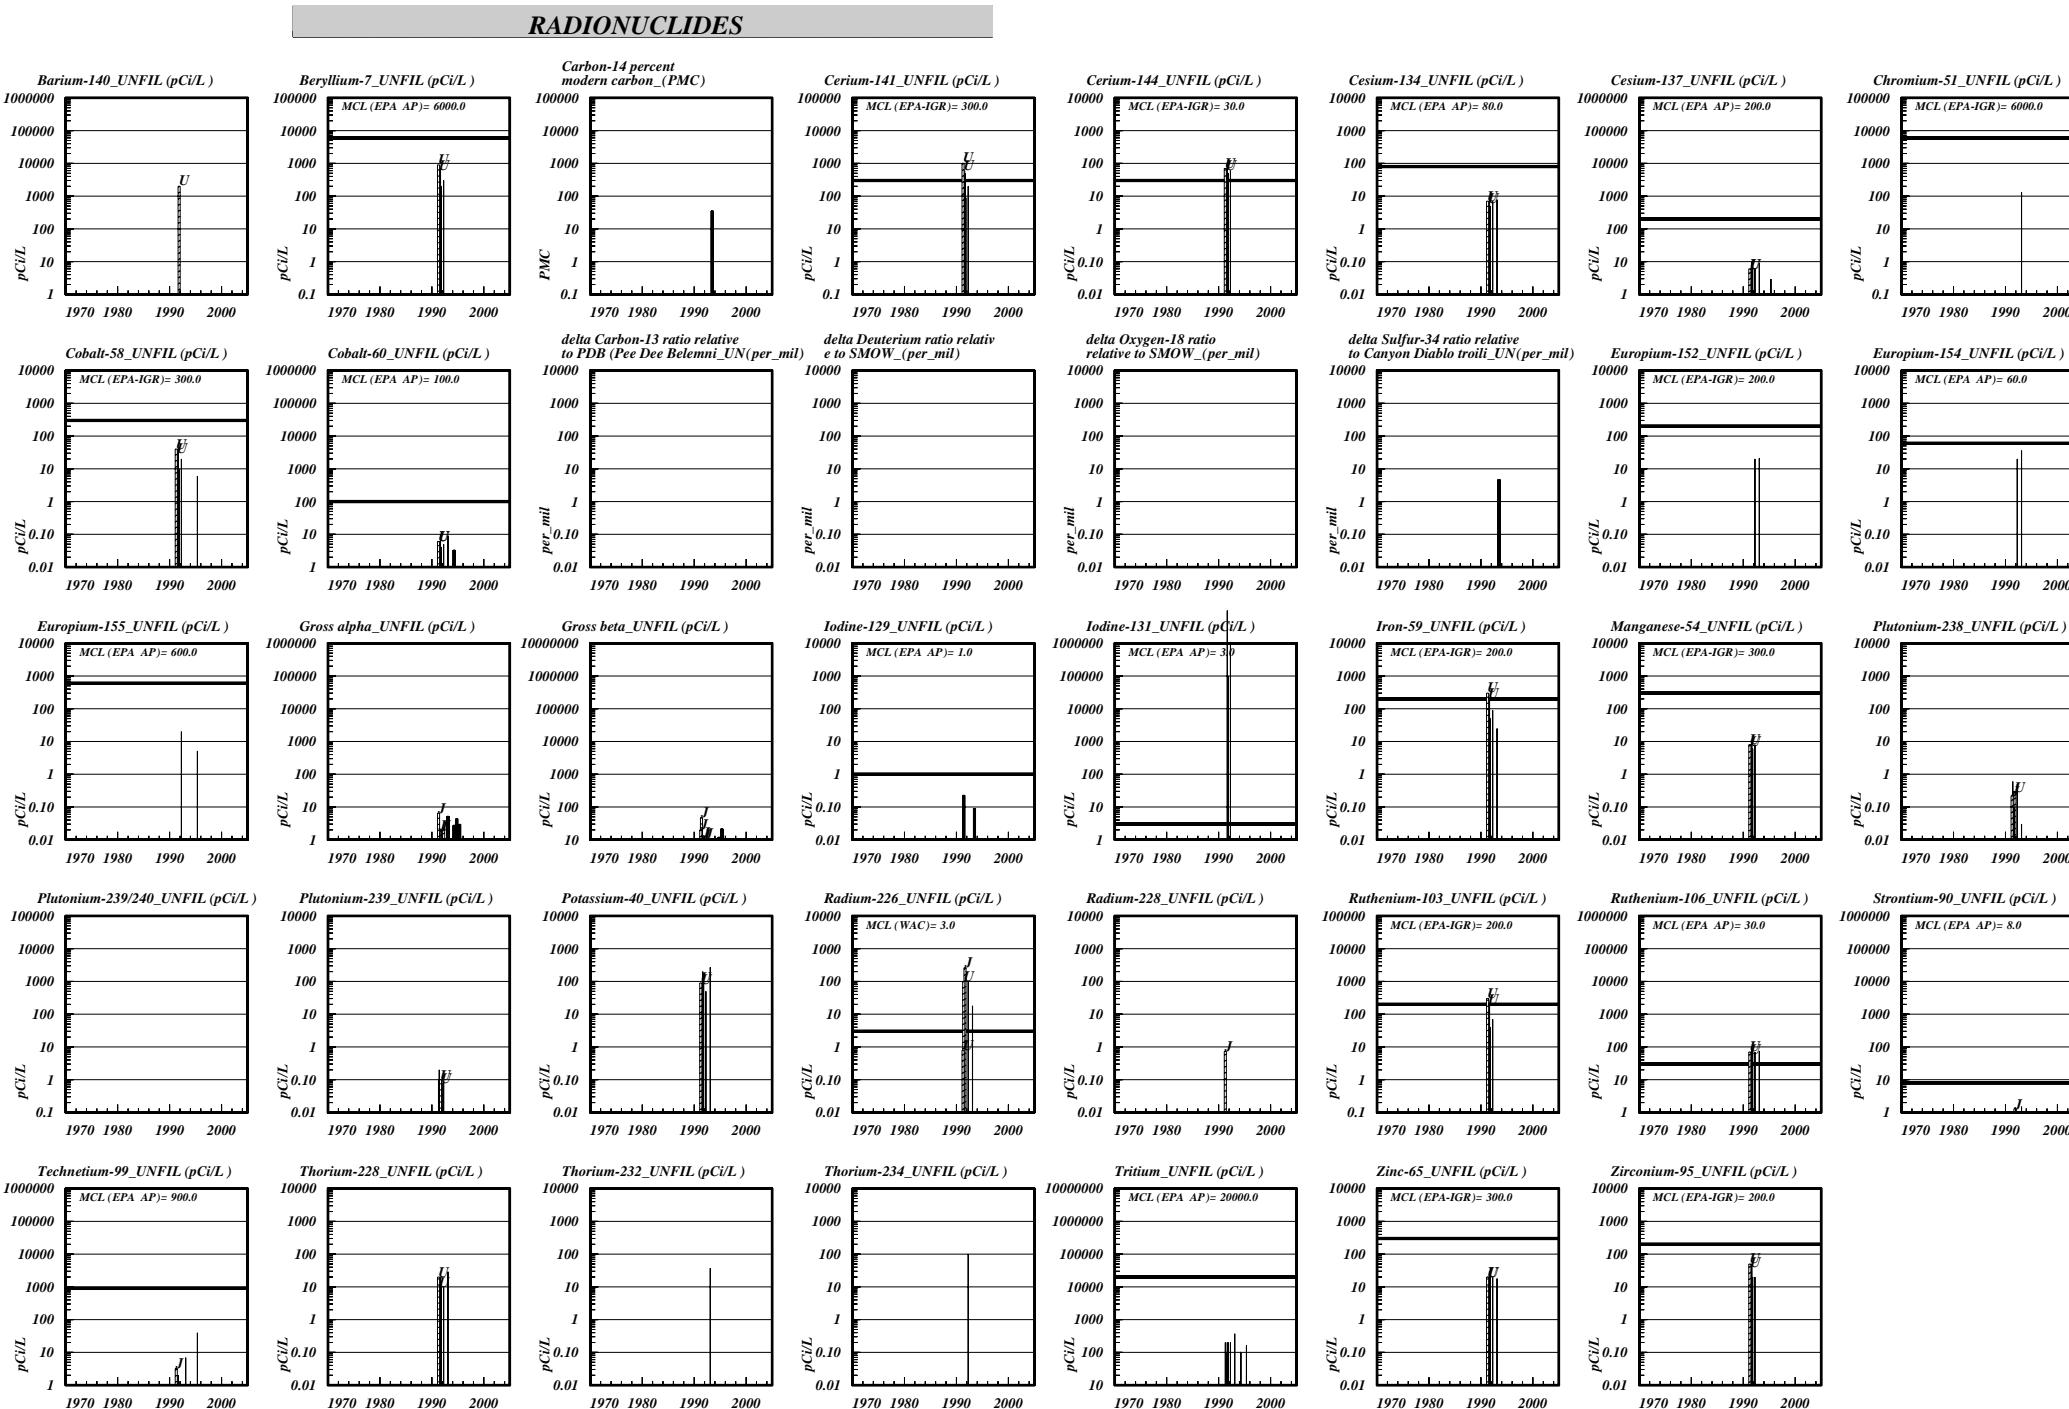


WELLNAME=299-E33-40 WELLID=A4866

Well Type=STANDARD Well purpose=GROUNDWATER  
 Owner=DOE Contact=BHI Well Adv Compliance=COMPLIANT  
 $X_{coor}=573546.30$   $Y_{coor}=137723.10$  Datum=NAD83(91) Date Survey=1/15/1993  
 Elevation= 190.001 Datum=NAVD88 Date Survey=01/11/93  
 Ref Point Desc=BRASS CAP Ref Point side=NONE Contractor=USACE(JECA)  
 Total Number of Screen Intervals=1  
 Screen#1 Screen diam= 4.50 in Top= 89.59 Bottom= 92.93 m Slot\_size= 0.01 in  
 Screen material=Stainless Steel  
 Total Number of Seals=10  
 Seal#1 Depth\_top= 0.79 Bottom= 6.13 m Material=Portland Cement  
 Seal#2 Depth\_top= 6.13 Bottom= 27.55 m Material=Bentonite Crumbles  
 Seal#3 Depth\_top= 27.55 Bottom= 60.11 m Material=Bentonite Slurry  
 Seal#4 Depth\_top= 60.11 Bottom= 70.10 m Material=Hole Plug Bentonite  
 Seal#5 Depth\_top= 70.38 Bottom= 85.59 m Material=Cement Grout  
 Seal#6 Depth\_top= 85.59 Bottom= 87.20 m Material=Hole Plug Bentonite  
 More Information is at <http://www.envirodataaccess.com/wellfiles/299-E33-40.htm>

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:


EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

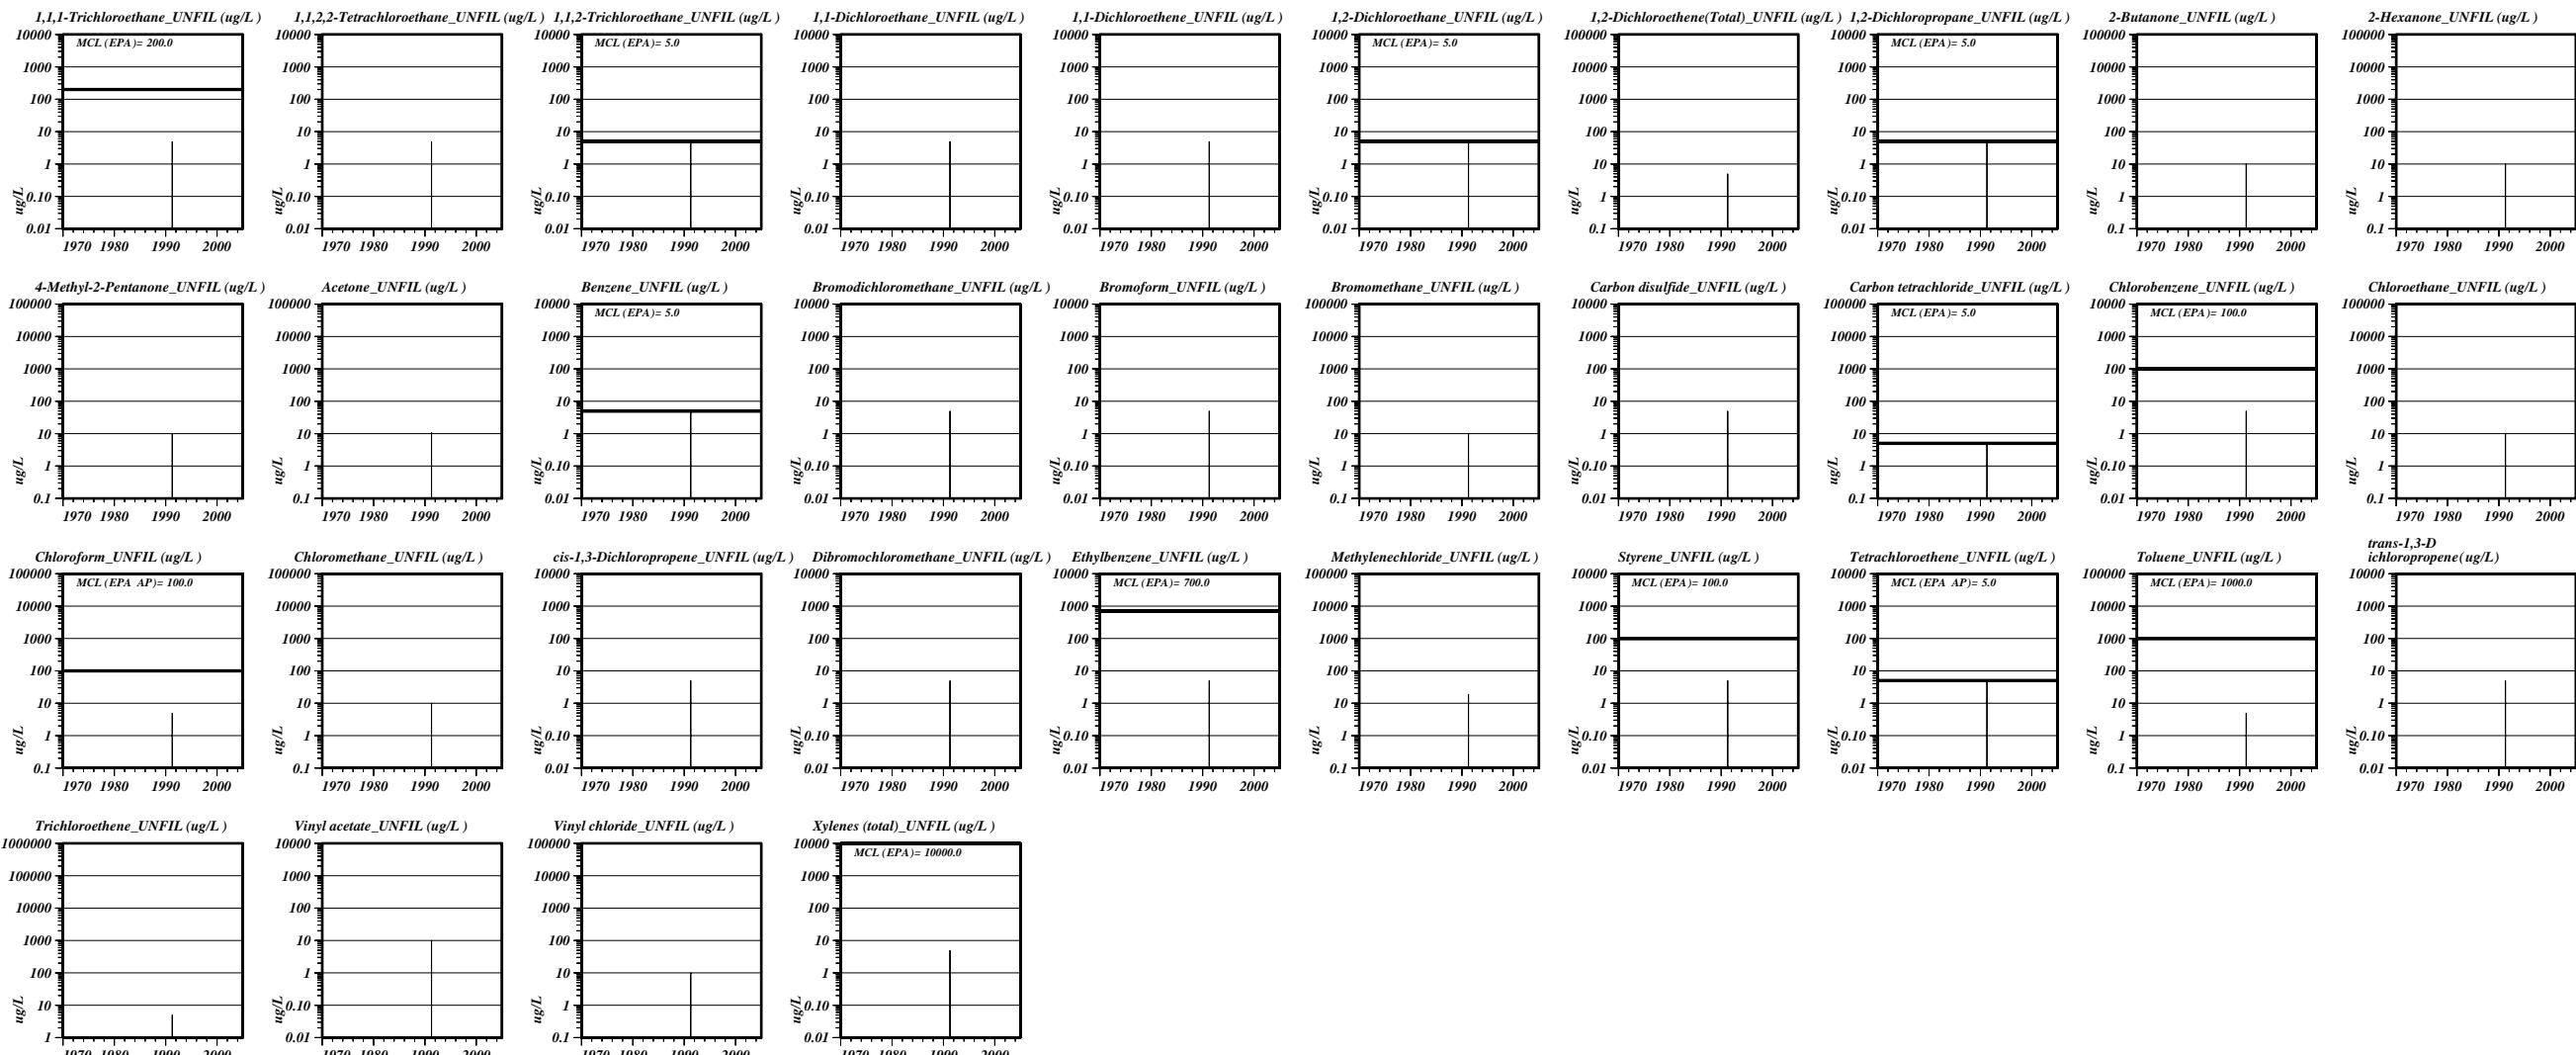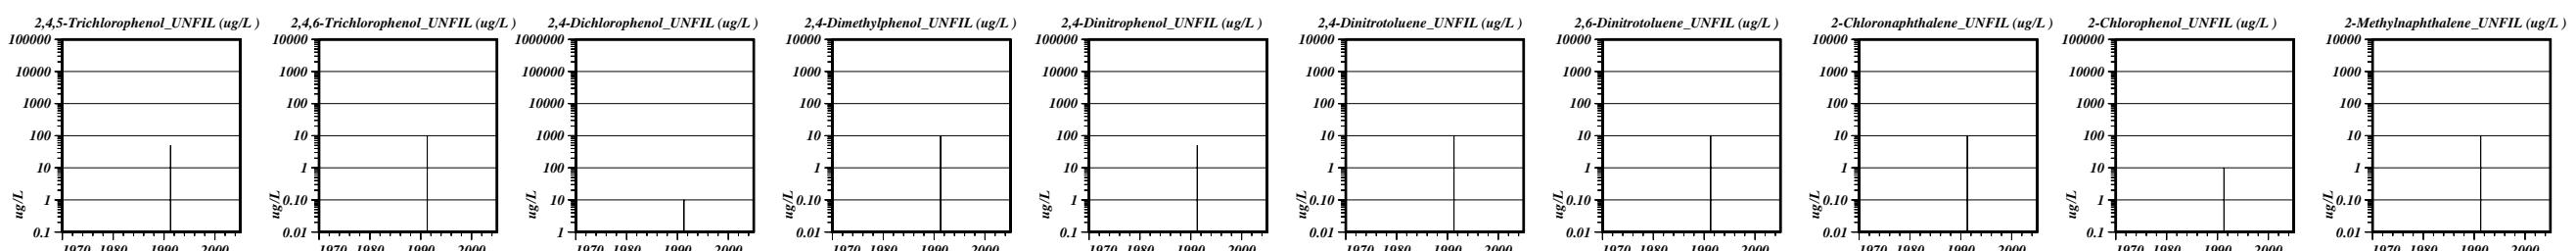**VOLATILE ORGANIC COMPOUNDS****SEMI-VOLATILE ORGANIC COMPOUNDS**

LABORATORY QUALIFIER FLAGS in HEIS are \*; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

## SEMI-VOLATILE ORGANIC COMPOUNDS

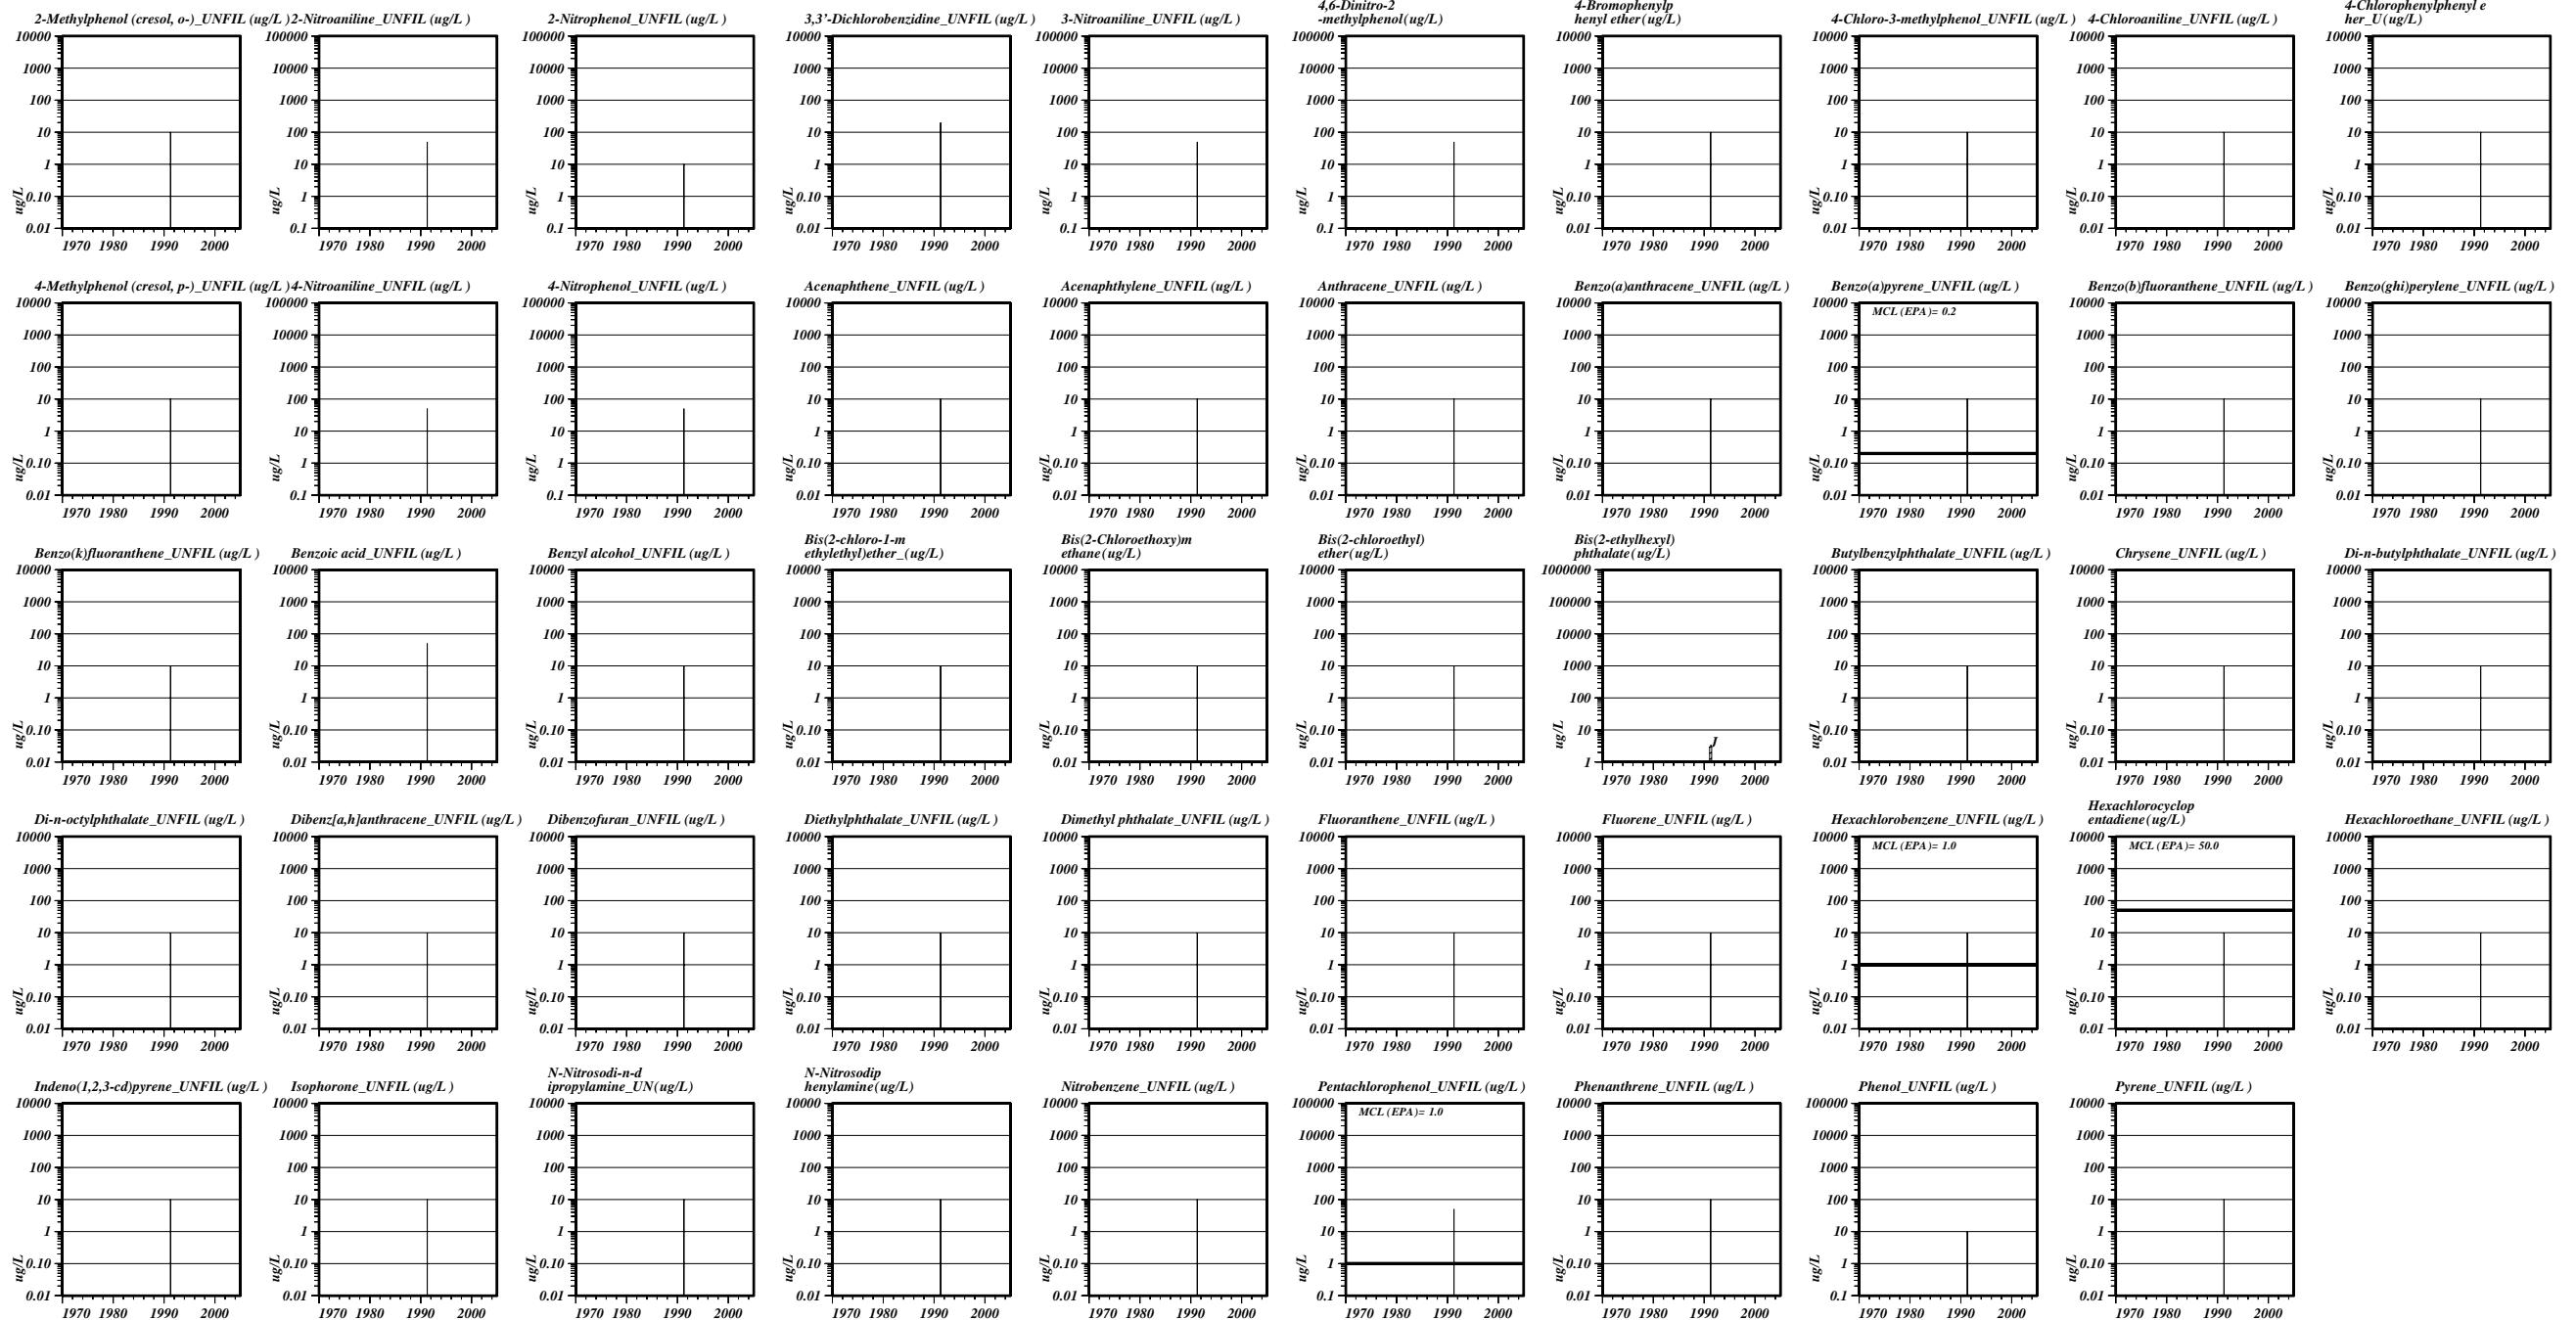


LABORATORY QUALIFIER FLAGS in HEIS are \*; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-E33-40

## METALS & PHYSICAL PARAMETERS

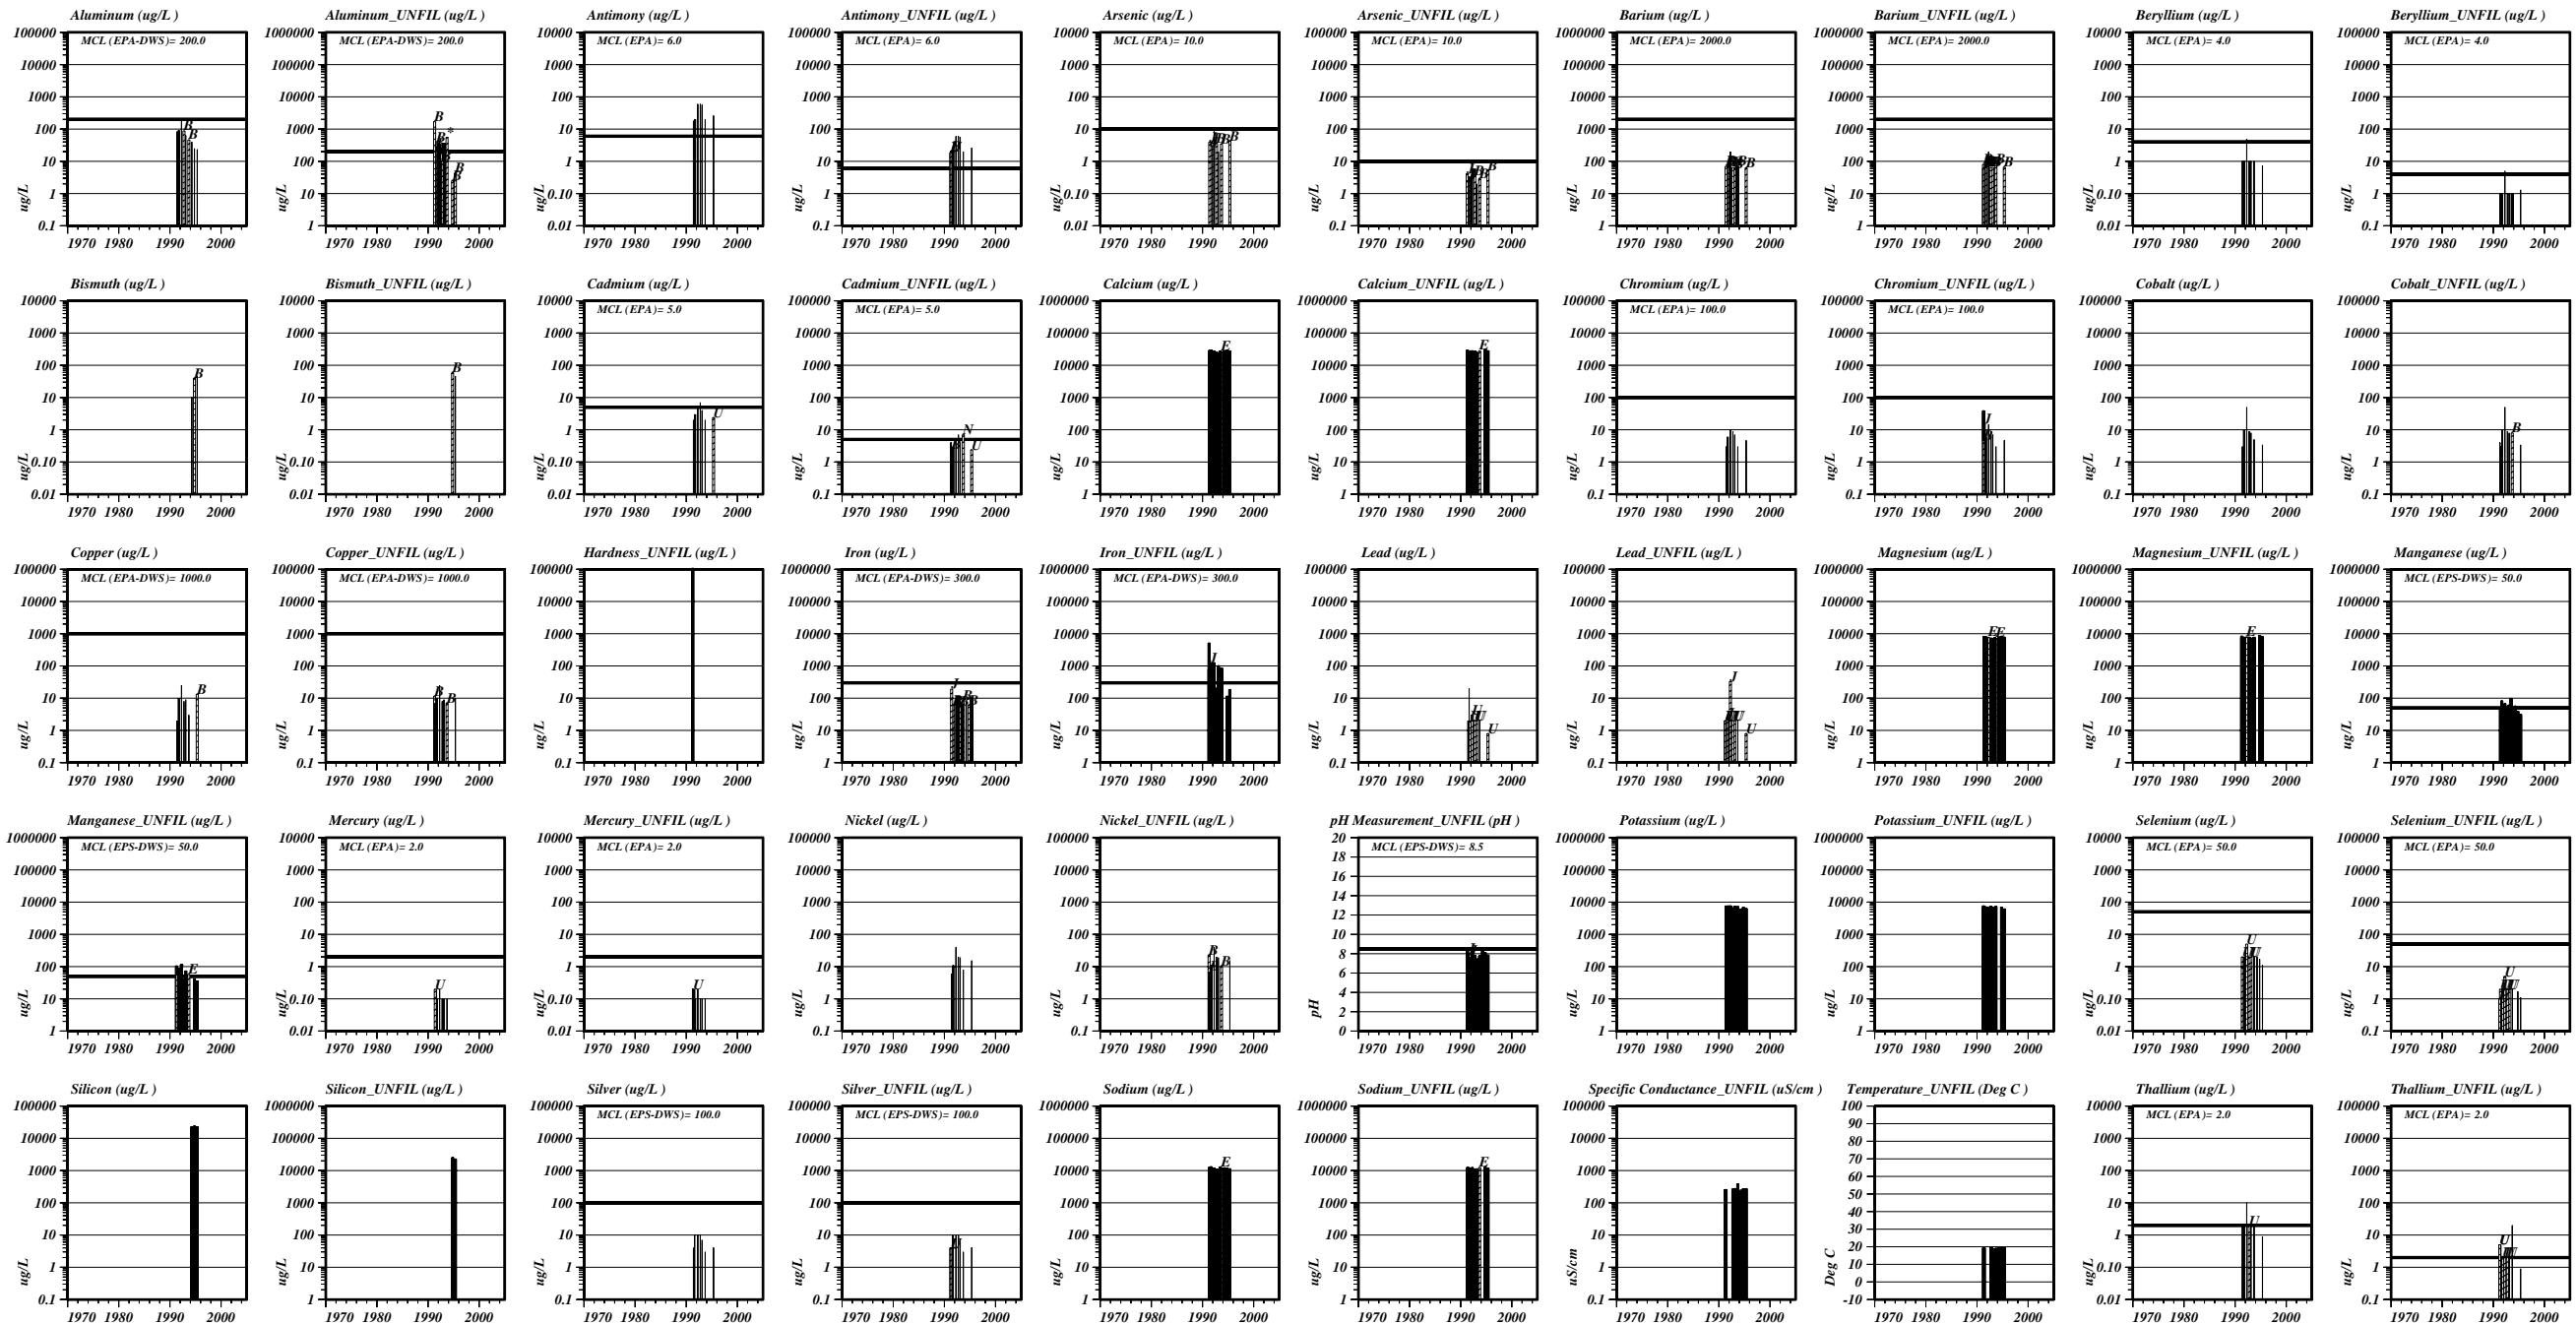


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-E33-40


## METALS & PHYSICAL PARAMETERS

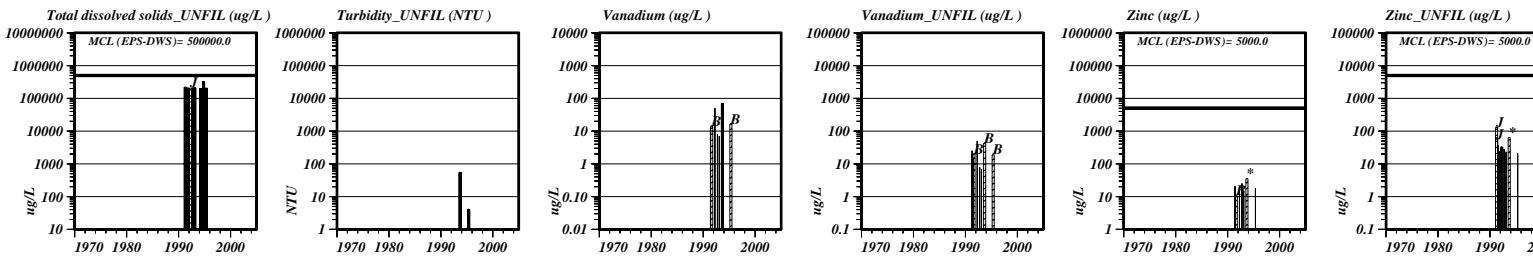

## PEST/PCB, HERB, & DIOXINS

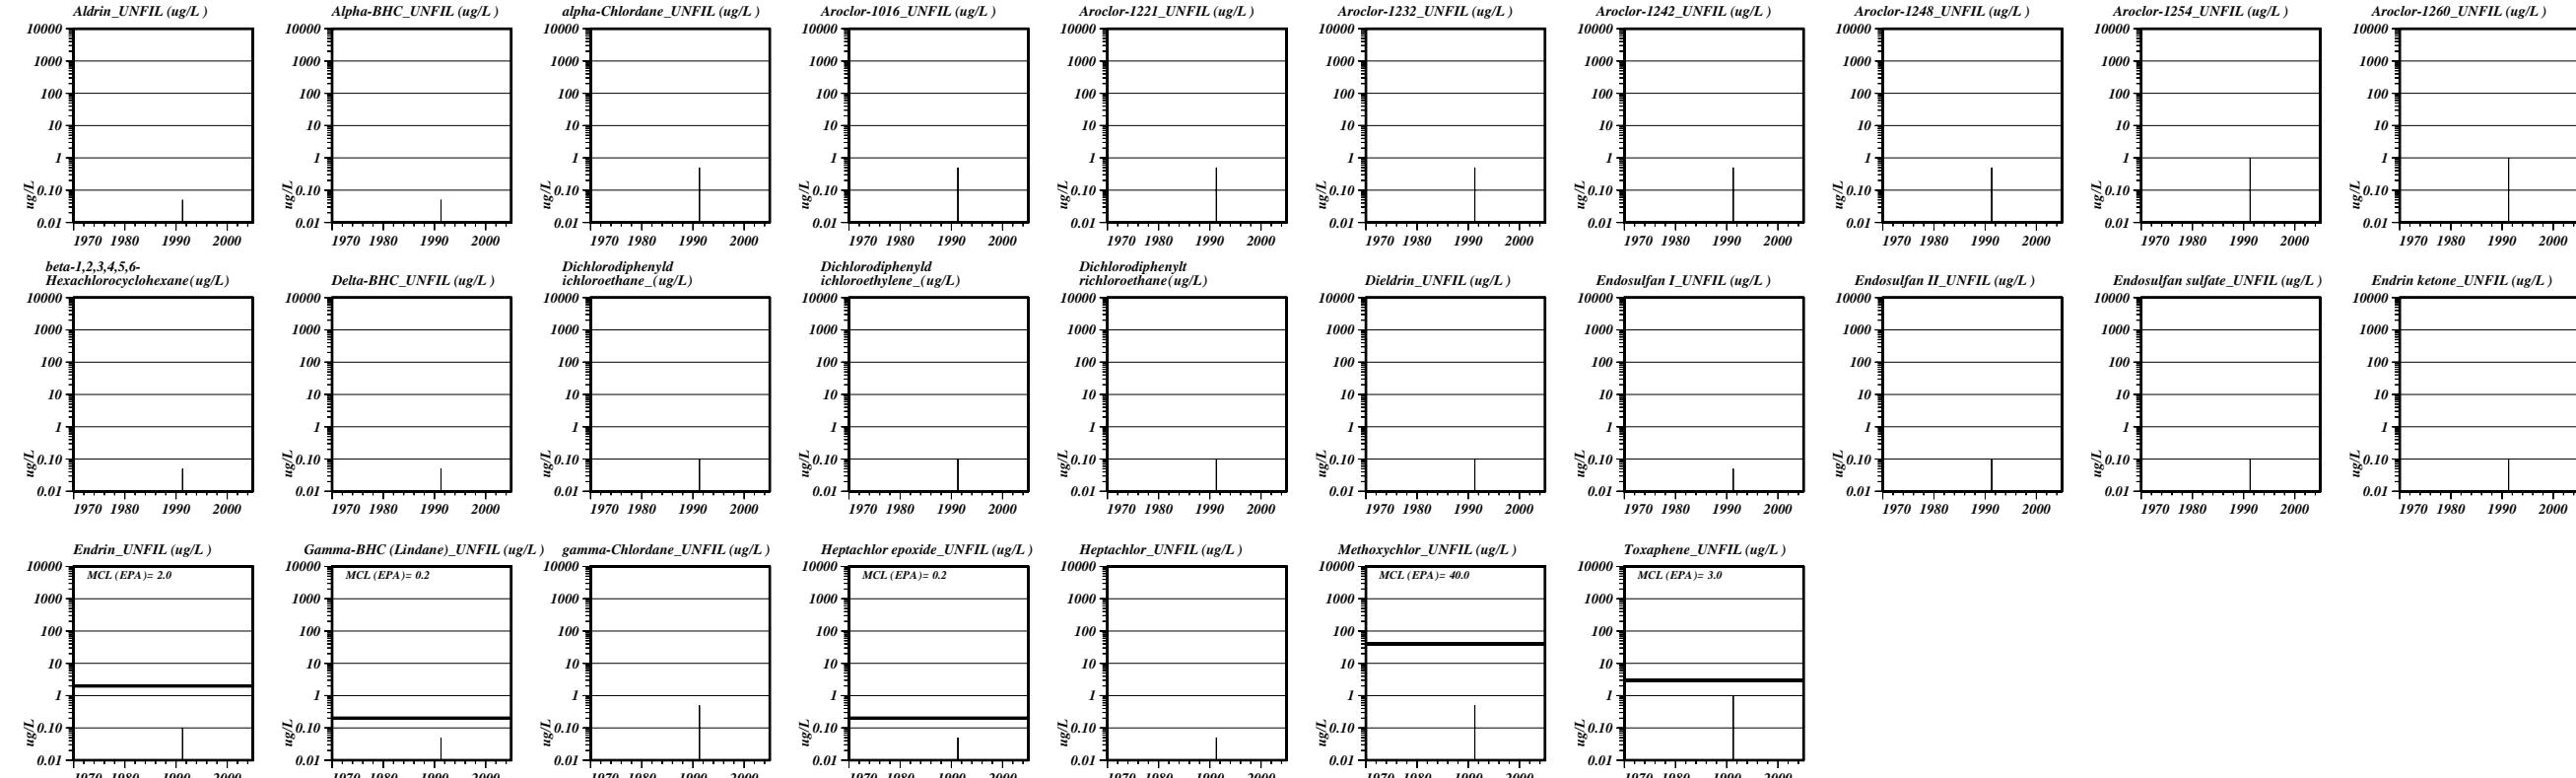

## GENCHEM & ORGANICS & GENORGANICS



LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag